Remarks	Own Article No. Drg./Pos.	Designation	Pos.	Material	Called off article No.	Weight per piece/kg	Number per unit
	841 324 296	RUNNER COUPLING	001	DIV.	-	-	1
	01 001	OF ITEM 001-009		-	*	-	

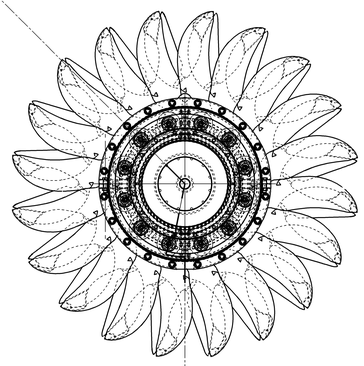

VIEW FROM GENERATOR SIDE

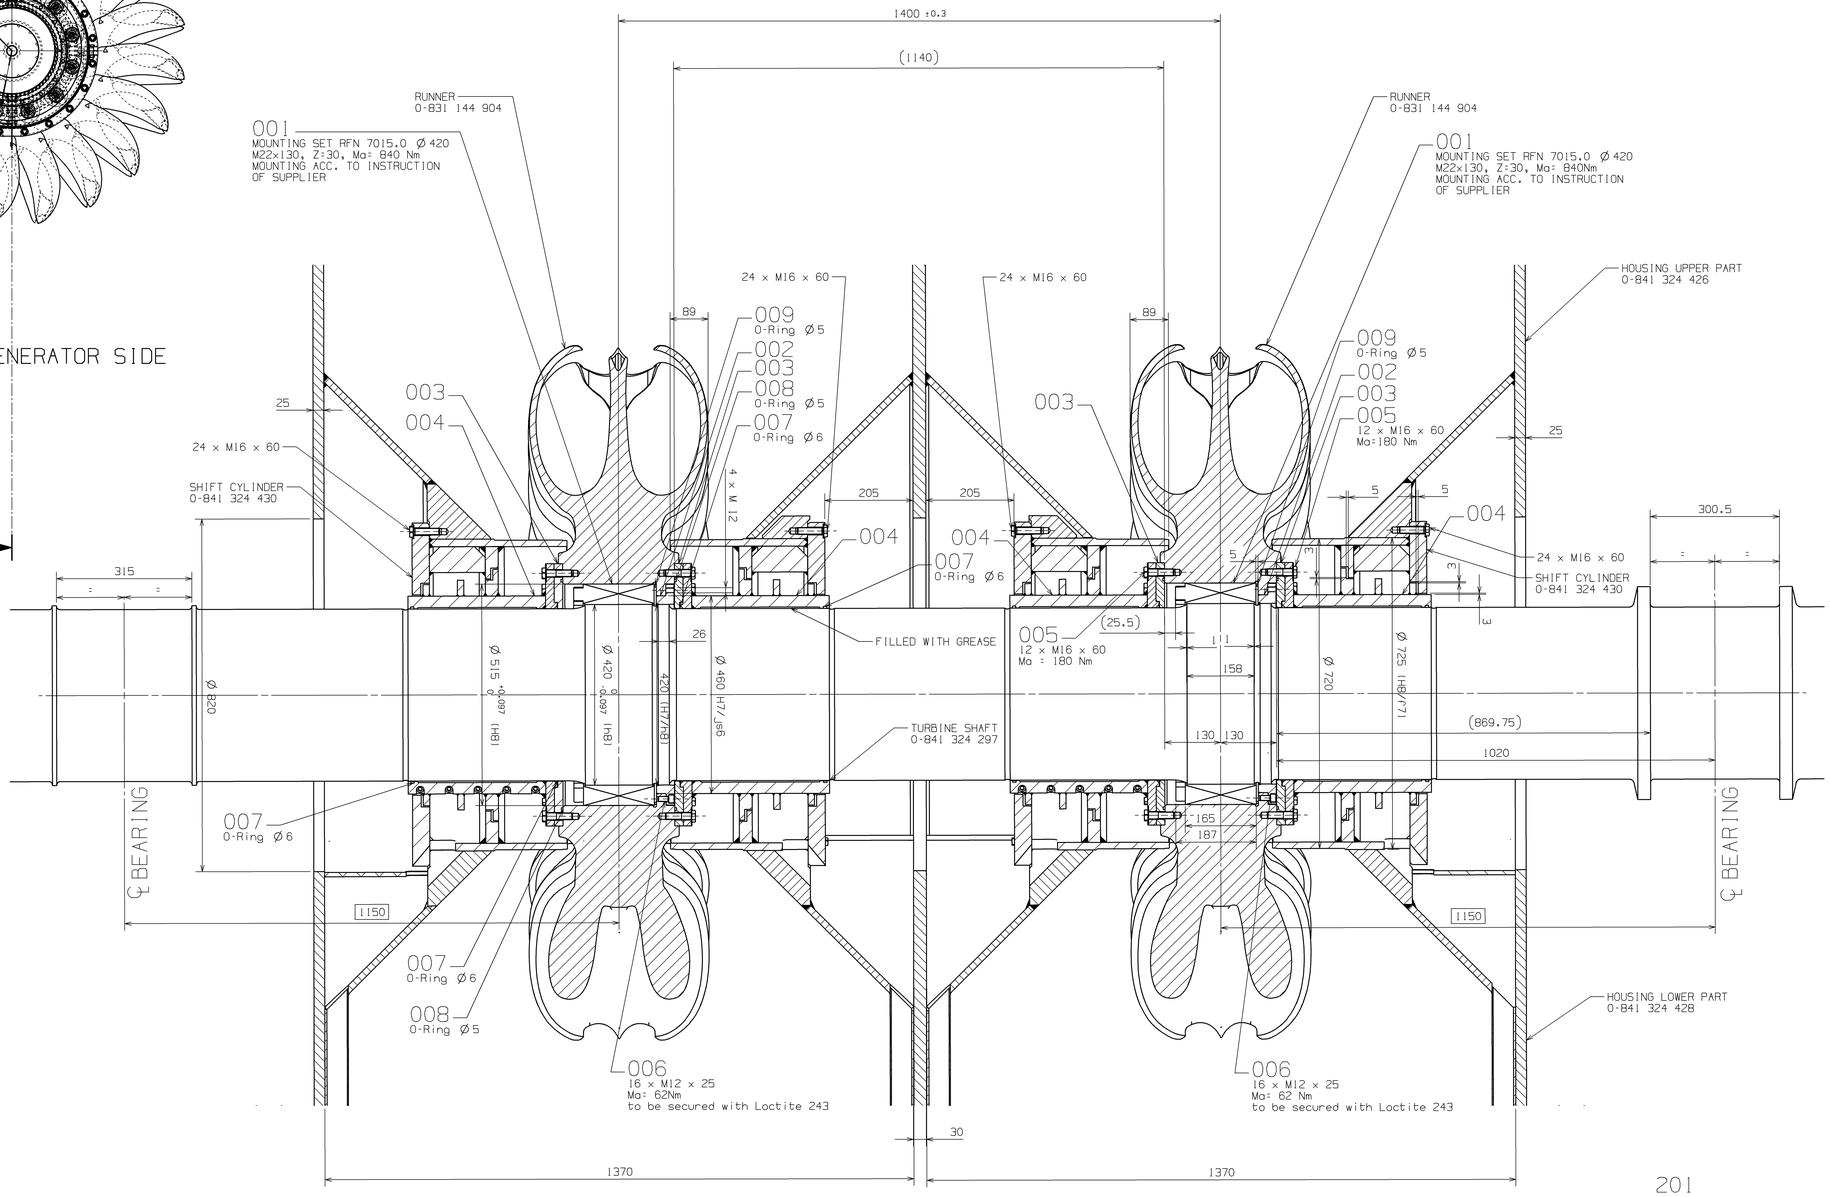

SECTION A-A

GENERATOR SIDE

201

REV. Rev.	DESCRIZIONE Description	DATA Date	VERIFICATO Checked	APPROVATO Approved
2				
1				
0	PRIMA EMISSIONE	11/01/2008	ALBE	ALBE

EDISON

CODIFICA DOC. / Doc. Number: N B L 4 1 B C 1 1 M Q 1 J

IMPIANTO / OPERA Plant: CENTRALE IDROELETTRICA PRATI DI VIZZE SOSTITUZIONE GRUPPI

COMMITTENTE Client

Modifications	Note	Name	Date	Checked	Date	Comments
	B	CAMENZIND	11.12.07	SIMMEN	11.12.07	BEARING POSITION ADDED
	A	CAMENZIND	27.11.07	SIMMEN	27.11.07	POSITION OF MOUNTING SET CHANGED
Original		CAMENZIND	11.10.07	SIMMEN	12.10.07	

	Designed	Date	Checked	Date	Final	Date	Approval	Date
Separate list: yes / no: no			BV		Original scale: 1 : 5			

02901	Designation: TURBINA PELTON ORIZONTALE	Original drawing: -
K130.00059	RUNNER COUPLING	Similar drawing: -
PRATI DI VIZZE		Replaced by:
CH-KRIENS		Substitute for:

VA TECH HYDRO — ANDRITZ

Lng: | 0,841,324 296 | B | Sheet

The copyright of these drawings and of all annexes which are entrusted to a person's care always remain the property of our firms. They must not be copied or duplicated nor shown to or placed at the disposal of third persons without our written consent.

Allgemeintoleranzen

DIN 7168 mittel
Fuer mechanische Bearbeitung.
ISO 13920 Genauigkeitsgrad B
Fuer Schweisskonstruktion

DIMENSIONAL VARIATIONS: 1.) FOR FINISHED DIMENSIONING ACC.TO DIN 7168 MEDIUM

NOMINAL DIMENSIONS	OVER	0,5	6	30	120	315	1000	2000	4000
	TO	6	30	120	315	1000	2000	4000	8000
TOLERANCE ± MM		0,1	0,2	0,3	0,5	0,8	1,2	2	3

DIMENSIONAL VARIATIONS: 2.) FOR HOLE CENTER-LINE DISTANCES ACC.TO DIN 7168 ROUGH

HOLE DISTANCE	OVER	6	30	120	315	1000
	TO	30	120	315	1000	2000
TOLERANCE ± MM		0,5	0,8	1,2	2	3

THIS DRAWING MAY ONLY BE MODIFIED BY SIGNING OF CAD SYSTEM.

UNIGRAPHICS
Date: 11-Feb-08 Time: 9:10
Drawing path: D:\Data\Unigraphics\Documents\K130\K130.00059_RUNNER COUPLING_B.prt Last Saved by: SIMMEN